

Assessment of the harmonic distortion in residential distribution networks: literature review

Evaluación de la distorsión armónica en sistemas de distribución residencial: revisión literaria

Joaquín E. Caicedo¹, Andrés A. Romero², and Humberto C. Zini³

ABSTRACT

Harmonic distortion in residential distribution networks is increasing due to the penetration of multiple nonlinear loads, including modern technologies such as plug-in electric vehicles and energy efficient lighting (e.g., compact fluorescent and LED lamps). The distributed nature of these loads introduces complexity in the analysis of harmonic propagation. Therefore, more sophisticated tools are needed to investigate this issue, on the basis of formerly established methodologies. This paper presents a literature review on the assessment of the harmonic distortion in residential distribution networks. To that end, bibliographic data of the most representative publications related to the topic were obtained. From these data, a novel citation analysis method was developed to construct a chronologically organized direct citation network. Based on the temporal evolution of the citation network, the aforementioned issue is presented, identifying lines of research and proposed methodologies. From the analysis of the literature review, the stages for modeling and simulating harmonic propagation are identified and described. The principal aspects to be addressed for obtaining an accurate harmonic analysis are also identified and detailed, namely, harmonic interaction, diversity, unbalance, and uncertainty. Finally, main conclusions are highlighted.

Keywords: Electric power system, harmonic distortion, power quality, systematic review.

RESUMEN

La distorsión armónica en redes de distribución está aumentando debido a la penetración de múltiples cargas no lineales, incluyendo tecnologías modernas como los vehículos eléctricos y las lámparas de alta eficiencia energética (por ejemplo, lámparas compactas fluorescentes y LEDs). La naturaleza distribuida de estas cargas introduce complejidad en el análisis de la propagación de armónicos. Por lo tanto, se necesitan herramientas más sofisticadas para investigar esta temática, sobre la base de metodologías establecidas. Este artículo presenta una revisión literaria sobre la evaluación de la distorsión armónica en las redes de distribución residencial. Para ello, se obtuvieron datos bibliográficos de las publicaciones más representativas relacionadas con el tema. A partir de estos datos, se desarrolló un nuevo método de análisis de citas para construir una red de citas directas, organizada cronológicamente. Con base en la evolución temporal de la red, se observan las líneas de investigación y las metodologías propuestas. Además, se identifican las etapas para el modelado y simulación de la propagación de armónicos y se detallan los aspectos para obtener un análisis armónico preciso, a saber, interacción armónica, diversidad, desequilibrio e incertidumbres. Finalmente, se presentan las conclusiones.

Palabras clave: Calidad de potencia, distorsión armónica, revisión sistemática, sistema eléctrico de potencia.

Received: May 16th 2017

Accepted: June 29th 2017

Introduction

Harmonic distortion is a power quality concern that can affect the electromagnetic compatibility of the electric power system. Such perturbation is mainly emitted by nonlinear loads, which drew non-sinusoidal currents that distort the voltage waveform. Harmonic distortion can cause malfunction and losses in equipment and lines of the electric power system, resonances with capacitor banks, interference with communication systems, etc. (Das, 2015).

In the early years, research on harmonic distortion was focused on large nonlinear loads due to their noticeable impact on power quality. However, the increasing use of residential electronic devices is causing a significant collective impact on distribution networks (Wang *et al.*, 2016). In fact, some studies have demonstrated substantial

¹ Electrical Engineer, Universidad Distrital Francisco José de Caldas, Colombia. Dr-Ing. candidate, Instituto de Energía Eléctrica (IEE), Universidad Nacional de San Juan (UNSJ) – Consejo Nacional de Investigaciones Científicas y Técnicas (CONICET), Argentina. Affiliation: IEE, UNSJ – CONICET, Argentina. E-mail: jcaicedo@iee.unsj.edu.ar

² Electrical Engineer, Universidad Nacional de Colombia. Dr-Ing., UNSJ, Argentina. Affiliation: Assistant Researcher, IEE, UNSJ – CONICET, Argentina. E-mail: aromero@iee.unsj.edu.ar

³ Electrical Engineer, Dr-Ing., UNSJ, Argentina. Affiliation: Senior Researcher and Consulting Engineer, IEE, UNSJ – CONICET, Argentina. E-mail: zini@iee.unsj.edu.ar

How to cite: Caicedo, J. E., Romero, A. A., Zini, H. C. (2017). Assessment of the harmonic distortion in residential distribution networks: literature review. *Ingeniería e Investigación*, 37(3), 72-84. DOI: <http://dx.doi.org/10.15446/ing.investig.v37n3.64913>



Attribution 4.0 International (CC BY 4.0) Share - Adapt

economic losses due to electrical losses (Duarte & Schaeffer, 2010; Santiago *et al.*, 2013) energy losses and the economic consequences of the use of small appliances containing power electronics (PE, and interference with telephone signals due to zero sequence harmonics (Bagheri & Xu, 2014; Jewel *et al.*, 2000).

The main challenges related to the analysis of small distributed harmonic sources are the difficulty in modeling their uncertain nature and time variability (Barros *et al.*, 2013; Romero *et al.*, 2011a) harmonic distortion in PS is a timevarying phenomenon because both linear loads (LL, the propagation and partial cancellation of harmonics due to phase angle diversity (Gil-De-Castro *et al.*, 2015), as well as the interaction between these nonlinear loads and the system (Mansoor *et al.*, 1995). Furthermore, the design of mitigation measures is more complex for distributed harmonic sources (Munir *et al.*, 2016), and the optimal location of capacitors for power factor correction also becomes more challenging due to possible resonances (Masoum & Fuchs, 2015). The complexity in modeling low-voltage networks is another challenge because of their topological characteristics, including: large number of buses and branches, unbalanced loads, multiphase operation and wide range of values of resistance and reactance (Teng *et al.*, 2014).

In forthcoming years, an increase of harmonic distortion in distribution networks is expected due to the connection of modern nonlinear loads such as Plug-in Electric Vehicles (PEVs) (International Energy Agency, 2017), and energy efficient lightning, including Compact Fluorescent Lamps (CFLs), and Light-Emitting Diode (LED) lamps (Blanco & Parra, 2011). Regarding PEVs, their charging would occur mainly at homes (Speidel & Bräunl, 2014) Hence, the analysis of PEVs impact on harmonic distortion should consider the aforementioned challenges related to distributed nonlinear loads, besides the aggravating fact that PEVs demand more power than typical residential loads.

In this context, this paper presents a literature review on the assessment of the harmonic distortion in residential distribution networks. The literature review is based on a novel method to construct bibliographic citation networks. Such proposed method is also presented in this work. The paper has been organized as follows: section 2 presents the method to structure the literature review. In section 3, the review is described. Sections 4 and 5 analyze and discuss the most important findings. Finally, section 6 remarks the conclusions.

Method to structure the literature review

The main areas of knowledge related to the topic were identified: 1) harmonic distortion in power systems; and 2) harmonic distortion in residential distribution networks. Also, other areas such as the impact of some loads are identified: 3) impact of PEVs on harmonic distortion, and 4) impact of energy efficient lighting on harmonic distortion.

These areas are related according to their hierarchy and size as is shown in Figure 1. For instance, the area '1' contains the areas '2', '3' and '4'.

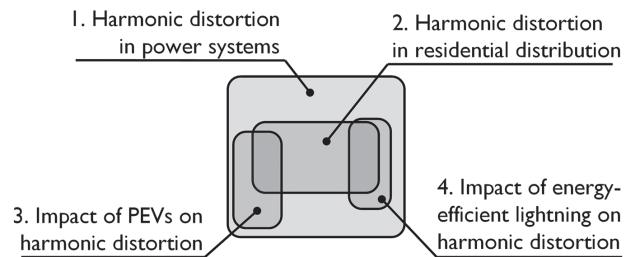


Figure 1. Relation of the areas of knowledge.

Source: Authors

Afterwards, similarly as it was done in a previous work by the authors (Caicedo *et al.*, 2014), the most important bibliography on each subject was identified by using the following set of search rules in titles, abstracts and keywords stored at the extensive catalog of citations, Scopus of the editorial Elsevier:

1. Harmonic distortion in power systems = Harmonic distortion AND Power system
2. Harmonic distortion in residential distribution networks = Harmonic distortion AND Power system AND Residential
3. Impact of PEVs on harmonic distortion = Electric vehicle AND Harmonic distortion AND Power system
4. Impact of energy-efficient lightning on harmonic distortion = Lightning AND Harmonic distortion AND Power system

To apply the aforementioned search rules, each term was defined by a set of synonyms and related concepts, as follows:

Electric vehicle: "electric vehicle" OR "electrical vehicle" OR "electric car" OR "electrical car" OR "electric drive vehicle" OR "electrical drive vehicle"

Harmonic distortion: harmonic OR "voltage distortion" OR "current distortion" OR "waveform distortion" OR "non-sinusoidal waveform" OR "nonsinusoidal waveform"

Lightning: "energy efficient lighting" OR "energy efficient lamp" OR "compact fluorescent lamp" OR "LED lamp"

Power system: "power system" OR "power network" OR "power grid" OR "electricity system" OR "electricity network" OR "electricity grid" OR "distribution system" OR "distribution network" OR "distribution grid" OR "voltage system" OR "voltage network" OR "voltage grid" OR "power transmission" OR "power transformer" OR "distribution transformer"

Residential: residential OR domestic OR house OR home OR residence OR urban OR public

The number of references obtained by searching with each rule is reported in Table 1. For the topic harmonic distortion in power systems, 20 561 results were found. This indicates an extensive base of knowledge. However, only 836 documents are related to harmonic distortion in residential distribution networks, which is the specific topic that is dealt within this paper.

Table 1. Number of references obtained with the search rules

Search rule	Type of document				Total
	Book	Journal article	Conference	Other*	
Harmonic distortion in power systems	28	9 160	10 779	594	20 561
Harmonic distortion in residential distribution	0	281	501	54	836
Impact of PEVs on harmonic distortion	0	114	238	36	388
Impact of lightning on harmonic distortion	0	30	75	3	108

Date of survey: 29/08/2017

*Other: Abstract report, book chapter, business article, conference review, editorial, erratum, note, report, review, short survey, letter

Source: Authors

The orientation of the literature review was based on a citation analysis. The theory of citation analysis provides tools for identifying patterns based on bibliographic data of scientific documents, in order to establish the evolution of research over time (Hicks & Melkers, 2013). Citation counts and citation networks are among these tools. Citation counts represent the impact of a document, whereas a citation network is a useful tool to establish relationships between research works (Persson, 2010).

The literature review was performed based on a citation network on the topic: harmonic distortion in residential distribution networks. To create the citation network, bibliographic data of journal articles for the topic were downloaded from Scopus. Also, bibliographic data obtained with the search rules for the impact of PEVs and efficient lightning on harmonic distortion were taken into account. Only journal articles were considered in the first search, because publishing in a journal implies a rigorous peer review process which usually ensures a high quality in content. The articles were analyzed briefly, reading all the abstracts and conclusions, thus the most related articles to the topic were identified as *Main* (M). Afterwards, the extension method proposed by Lindahl (2012) was applied with some modifications. The objective of the extension method was to identify and include the articles that were omitted by the search rules.

The extension method consists in identifying *Citing* journal articles (C), which cite two or more main articles (M), and *Referred* journal articles (R) which were cited by two or

more main articles (M). Hence, this method is based on the concepts of co-citation and bibliographic coupling as a measure of similarity in content (Persson, 2010). After applying the extension method, C and R articles were briefly analyzed to identify those strongly related to the topics. Finally, the citation network was built by using M, and the journal articles selected from C and R.

In the resulting citation network, each article is represented by a circle whose size is proportional to the number of times it is cited by other articles in the network. Links are represented by directed arcs from the article that cites to the cited one. However, as citation networks are usually difficult to interpret because of the large number of links, then, the 'Weighted Direct Citation Index' (WDC) (Persson, 2010) was used to weight the links. Once a weighted citation network (*i.e.* a citation network with links strengthened by WDC values) was created, only the citation with the highest WDC value was considered for each article, to eliminate several links and simplify the network, allowing to identify lines of research. Links with a WDC with value of one were also eliminated. Afterwards, the network was organized chronologically to observe the evolution of lines of research.

In the following section, the citation network is presented and some of the observed research lines are analyzed, highlighting performed contributions and proposed methodologies.

Harmonic distortion in residential distribution networks: literature review

Figure 2 shows the citation network for the issue harmonic distortion in residential distribution networks. For the sake of space, only some lines of research are described. However, most of the articles of the network are considered in the analysis and discussion, including the isolated ones.

Several investigations on harmonic distortion in residential distribution networks were performed in the 1990s as is shown in Figure 2. The main reason was the incorporation of a new nonlinear load: CFLs. For instance, in the work by Pileggi *et al.* (1993), residential feeders were simulated with CFLs. That study demonstrates the inverse linear relationship between linear load connected to the network and measured THDV (Total Harmonic Distortion in Voltage). This effect is due to damping of harmonic distortion caused by shunt linear loads. According to Figure 2, the research by Pileggi *et al.* (1993) led to the work by Emanuel *et al.* (1994, 1995) battery chargers, PC's, TV's and electronically ballasted lights. The analysis is based on the determination of the most harmonic susceptible busses and their response to each harmonic frequency. A new expeditive method that takes into account the background harmonic voltage phasor, and an equivalent bus impedance was developed and used to compute the maximum non-linear loads that yields VTHD = 5%, (Voltage Total Harmonic Distortion).

The evolution of a line of research is remarkable, since the same authors reported progress in their work. At first, the distortion caused by CFLs was studied (Pileggi *et al.*, 1993). Afterwards, the distortion caused by a variety of nonlinear loads was analyzed (Emanuel *et al.*, 1994) battery chargers, PC's, TV's and electronically ballasted lights. The analysis is based on the determination of the most harmonic susceptible busses and their response to each harmonic frequency. A new expeditive method that takes into account the background harmonic voltage phasor, and an equivalent bus impedance was developed and used to compute the maximum non-linear loads that yields $VTHD = 5\%$, (Voltage Total Harmonic Distortion. Finally, a forecast of THDV in the previously studied networks was estimated, for the next two decades (Emanuel *et al.*, 1995).

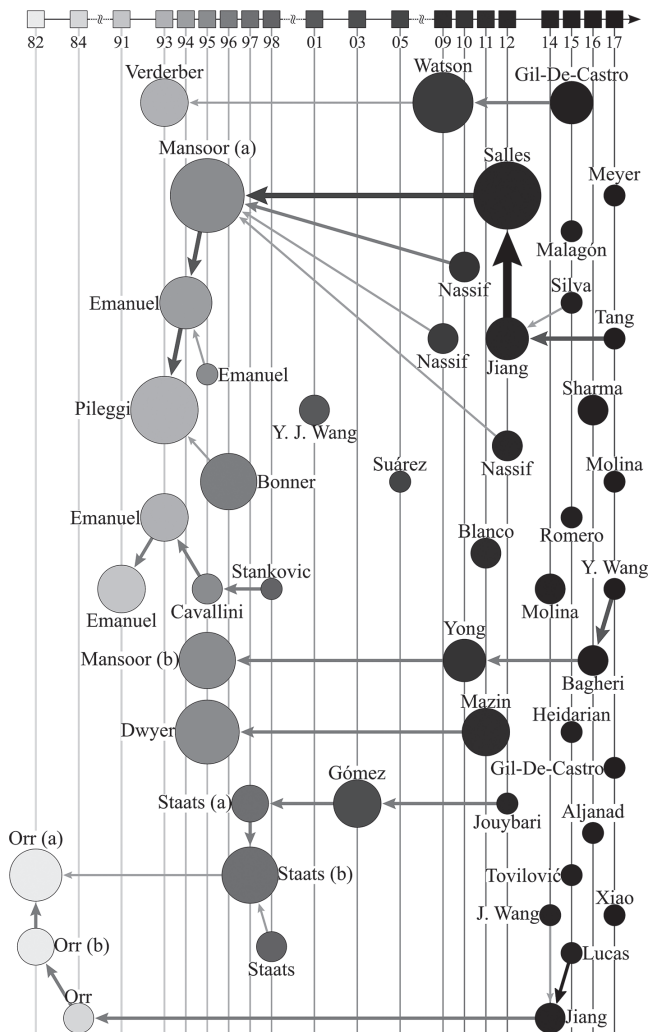


Figure 2. Chronological citation network related to harmonic distortion in residential distribution networks.

Source: Authors

Figure 2 shows that research conducted by Emanuel *et al.* (1994), led to the work by Mansoor *et al.* (1995a), where the harmonic interaction and diversity effect in harmonics produced by a large number of single-phase electronic loads were investigated. An analytic model was developed

for a single-phase full-wave rectifier, typically utilized in residential loads. From several case studies, the authors concluded that the constant harmonic current source model leads to overestimation of distortion, since the effect of harmonic interaction (which leads to attenuation or amplification) is omitted. This finding is of paramount importance in the analysis of harmonics in residential distribution networks. However, the model complexity hinders the application to scenarios of mass penetration of nonlinear loads. On this basis, several works investigated the harmonic interaction. For instance, Nassif *et al.* (2009, 2012) proposed the equivalent lamp index to characterize the harmonic attenuation on CFLs. Further developments were achieved by Nassif *et al.* (2010) proposing a method for obtaining suitable nonlinear load models for harmonic load-flow calculations based on extensive field measurements.

Following the line of research derived from Mansoor *et al.* (1995a), Salles *et al.* (2012) proposed a probabilistic bottom-up approach based on Monte Carlo simulation to assess the collective impact of residential nonlinear loads. Residence models were constructed by using probable operating states (on/off) of typical home appliances. Thereby, the impact on harmonic distortion in the secondary distribution network was assessed. Afterwards, aggregated models were obtained to assess the impact on the primary distribution network. The methodology takes into account variability over time of harmonics and the bottom-up approach facilitates the investigation on the influence of market trends and regulations. Nonetheless, the harmonic interaction was not taken into account and extensive input data are required. Jiang *et al.* (2012) presented applications of the described methodology. For instance, the effect of CFLs on a distribution network was forecasted, according to market trends. Results revealed a 10% growth rate in THDV for the following two years after the study.

Bearing in mind the same line of research, Silva *et al.* (2015) presented a methodology to assess unbalanced distribution networks, considering load variation. Despite the simple application and the accounting of cancellation without diversity factors; it provides little understanding of the diversity effect and the harmonic interaction. Concluding this line of research, according to Figure 2, appeared Tang *et al.* (2017) with a method to establish harmonic current responsibilities at the PCC of residential networks.

In other line of research, the data collected by Emanuel *et al.* (1991, 1993) in extensive surveys, was used by Cavallini *et al.* (1995) to propose a deterministic-stochastic approach to calculate the Probability Density Function (PDF) resulting from the sum of harmonic currents in distribution network buses. The novelty of this work lies in considering the variation patterns of harmonics over time from a deterministic component, coupled to a component which takes into account the randomness of distortion. A similar approach was proposed by Stankovic & Marengo (1998), using Markov chains to model the stochastic component.

According to Figure 2, a line of research was initiated by Dwyer et al. (1995). In that work, the impact of CFLs on harmonic distortion was studied through simulations in time domain to analyze the effect of partial cancellation caused by diversity. Furthermore, simulations in frequency domain were carried out to investigate the propagation of harmonic currents. The authors concluded that a massive penetration of CFLs may cause the violation of harmonic distortion limits allowed by the standards. Afterwards, Mazin et al. (2011) presented a method to determine the contribution of a residence to harmonic distortion, by using measurements. Findings from this study show that voltage distortion at the Point of Common Coupling (PCC) was mainly due to the system contribution.

In the early 1980s, one of the first concerns regarding the impact of PEVs on power quality of the electric utility appeared, in effect, harmonics generated by PEV battery chargers. In the work by Orr et al. (1982a), an analysis of harmonic currents generated by a cluster of PEV battery chargers was carried out. Chargers with a very simple topology consisting of a step-down transformer and a full-wave rectifier were assessed. A Monte Carlo simulation method was proposed, considering battery and charger parameters; start time of charging; initial SOC of batteries; and the number of connected PEVs to a single bus. Results demonstrate that harmonic amplitudes are highly dependent on the start time and the number of PEVs. Orr et al. (1982b, 1984) complemented their work, firstly, by studying the harmonic currents of different types of PEVs, and secondly, with an improved approach to predict the harmonic currents affecting the substation transformer, considering the random distribution of PEVs along low voltage feeders. On the basis of these works, Jiang et al. (2014) introduced more detail in modeling the probabilistic aspects related to PEVs. Moreover, other works analyzed the effect of charging stations (J. Wang et al., 2014), and fast charging of PEVs on harmonic distortion (Lucas et al., 2015).

According to Figure 2, other line of research derived from the work by Orr et al. (1982a), led to the research by Staats et al. (1997b). In that work, an analytic method to predict the injected harmonic currents by a concentration of PEV battery chargers was proposed. Such method is quite similar to the one presented by Orr et al. (1982a) in the initial considerations, therefore, it has similar drawbacks such as assuming all PEVs connected to a single bus. Besides, the method was based on a single type of battery charger. Despite these disadvantages, the method was very detailed in the modeling of start time of charging and initial SOC as PDFs. Thus, partial harmonic cancellation due to diversity in phase angles is taken into account. In addition, theoretical calculations without iterations can be achieved, reducing computation time drastically. Based on the same method, besides Monte Carlo simulation, further developments were achieved by Staats et al. (1998) by computing the statistics of harmonic voltages at each bus in a residential network. From the results, the probability that

THDV will not exceed the limit established by standards was evaluated.

Based on previous works, some researches focused on the investigation of the impact of PEVs on distribution transformers. For instance, Staats et al. (1997a) determined the relation between PEVs penetration and substation transformer derating, based on the transformer hot-spot temperature and life expectancy, while also considering the effect of harmonic currents. Following this line of research, Gómez & Morcos (2003) developed a computer tool to determine the life consumption of distribution transformers based on the thermal-aging rate and loss-of-life of the transformer, and the characteristics of connected PEV battery chargers. The impact of PEV chargers on the increase in load on transformers, cables, circuit breakers and fuses was also investigated. On a similar basis, Jouybari et al. (2012) studied the effect of PEV battery charging on transformer derating. To that end, the authors utilized the statistical models and battery charging characteristics investigated by Staats et al. (1997b) to represent randomness in input parameters. Then, a harmonic load-flow was carried out, using a backward/forward sweep-based method. Finally, the effects of harmonics on transformer K-factor and life-span were analyzed.

Analysis of the literature review

From the literature review, the stages to carry out the assessment of harmonic distortion in distribution networks by modeling and simulation were identified. The impact of multiple distributed small harmonic sources was emphasized. In the following sections, stages, models and methods for harmonic propagation analysis are described.

Harmonic source modeling

The electrical model, as well as the operating state model, should be defined to adequately represent harmonic sources Salles et al. (2012). Magnitude and phase angle of harmonic currents drawn by a nonlinear load depend on the electrical model. The operating state model represents time variation of harmonic sources, allowing for modeling uncertainty. Figure 3 shows a classification of harmonic source models.

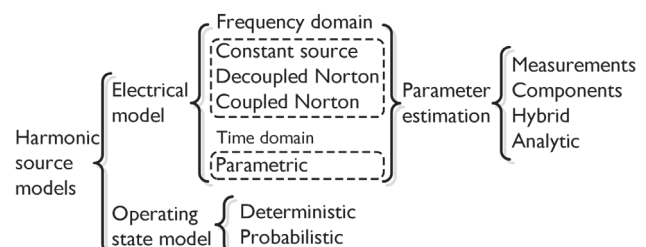


Figure 3. Classification of harmonic source models.

Source: Authors

Electrical model

In Figure 4, the models of harmonic sources in frequency domain are depicted. The constant source model (see Figure 4(a)) is represented as a complex current with fixed magnitude and phase angle obtained from the typical harmonic spectrum of the nonlinear load (Bonner et al., 1996). Moreover, the decoupled Norton equivalent is formed with a constant current source, connected in parallel to an admittance, as is shown in Figure 4(b). The constant current source represents harmonics due to the fundamental component of voltage. The admittance allows to consider the attenuation/amplification, but only for voltages and currents of the same harmonic order (Nassif et al., 2010). The coupled Norton equivalent is shown in Figure 4(c), where the connection of a constant current source and an admittance is depicted, similarly as the decoupled Norton equivalent. In addition, a voltage dependent current source in parallel, represents the deviations caused by the interaction of harmonic currents and voltages of different order (Yong et al. 2010). Finally, in the parametric model, components of the nonlinear load (semiconductors, resistors, capacitors, inductors, etc.) are characterized. Hence, detailed knowledge of the load is required (Mansoor et al., 1995a).

Modeling of nonlinear loads may also be classified by the way for estimating the model parameters. For instance, the modeling based on measurements (top-down) yields nonlinear load parameters from extensive measurements (Nassif et al., 2010). Moreover, the approach based on components (bottom-up) allows to obtain aggregate models, from individual components (Salles et al., 2012). On the other hand, the analytic approach yields expressions from the theoretical examination of the non-linear load operation (Mansoor et al., 1995a). Finally, there are hybrid approaches which combine various types of modeling. For instance, Yong et al. (2010) combine measurements and analytic examination to obtain the model for full-wave rectifier-based loads.

Operating state model

The operating state may be deterministic when the nonlinear load is considered a source of constant parameters, which represents the steady-state performance. On the other hand, the probabilistic approach models the variation over time of harmonic currents. Thus, the uncertainty in the operation of a nonlinear load may be modeled as a PDF.

Distribution network modeling

The scope of the distribution network model depends on the target of the harmonic analysis and the availability of network data. In the literature, four main aspects have been taken into account. The first one is the unbalance. In this regard, considering unbalance implies modeling of multiphase networks, including impedances of each phase and the neutral conductor. Otherwise, only the single-phase representation of the network is modeled. The second main aspect is the model of primary and secondary

distribution. The target of the harmonic analysis defines whether both, the primary distribution network (between ~ 1 kV and ~ 69 kV), and the secondary distribution network (less than ~ 1 kV), should be modeled. The third aspect is the distribution transformer model, given the fact that several harmonic studies focus on assessing the impact on distribution transformers. Therefore, specific models for transformers are developed to represent suitably their frequency response. The last aspect is the linear load models, which may be aggregated or detailed, and they should properly represent the effect on the network frequency response.

Harmonic sources penetration modeling

The level of penetration of harmonic sources may be deterministic, when it is approximately estimated, based on knowledge of the specific network. In the case of new nonlinear loads, certain levels of penetration, which are of particular interest, can be defined. For instance, the scenario in which the THDV limit (usually 5%) is exceeded in one or more buses is of particular interest. Moreover, probabilistic approaches model the level of penetration based on statistics from trends in the use of specific nonlinear loads, in a particular place. For future scenarios, these probabilistic models are used to forecast the level of penetration, based on market trends of the new nonlinear load to be studied.

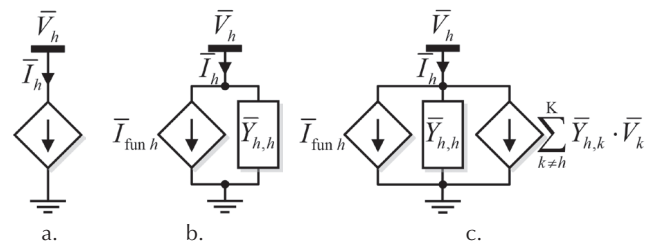


Figure 4. Models for harmonic sources in frequency domain: (a) constant current source; (b) decoupled Norton; and (c) coupled Norton. **Source:** Authors

Analysis and simulation of the harmonic propagation

Figure 5 presents a classification of methods for analysis and simulation of harmonic propagation in power systems. In this section, a brief description of each method of Figure 5 is presented.

Time domain methods

In time domain, the conventional solution (brute force) and the fast periodic steady-state solution are distinguished (Medina et al., 2013). In these methods, voltage and current waveforms are obtained by integrating the differential equations that describe the steady-state of the system. Then, harmonic components of the waveforms are computed, by using Fourier analysis.

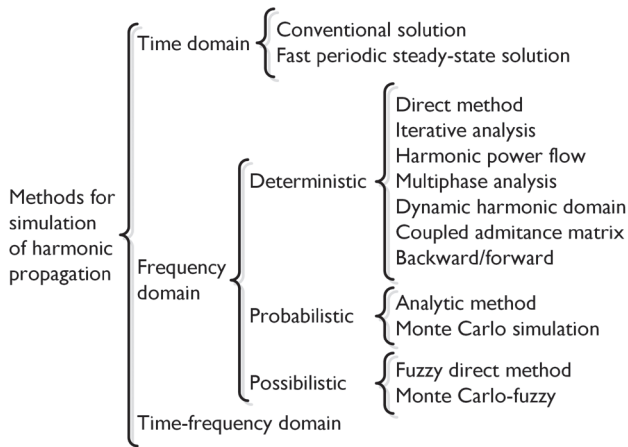


Figure 5. Classification of methods for the simulation of harmonic propagation.

Source: Authors

The computational effort in the conventional solution increases exponentially with the size of the system. In the fast periodic steady-state approach, the convergence of the solution is accelerated, by applying the Newton-Raphson method to obtain the steady-state.

Frequency domain deterministic methods

In the direct method, the harmonic currents are calculated at each bus, from the fundamental voltage and the characteristics of nonlinear loads. Then, bus harmonic voltages are computed, from the system admittance matrix, and the harmonic currents. For the iterative harmonic analysis, nonlinear loads are modeled as voltage dependent current sources. Harmonic voltages at buses are calculated in each iteration. Then, new harmonic currents are computed with the obtained harmonic voltages. The process is repeated until the solution converges (Medina et al., 2013).

The complete harmonic load flow was introduced by Xia & Heydt (1982), based on the Newton-Raphson algorithm. The solution is obtained by using the set of nonlinear equations of the conventional load-flow, together with the equations related to nonlinear loads. In a further improvement, namely, the multi-phase harmonic analysis, the three phases and neutral conductors of the network are modeled. Hence, uncharacteristic harmonics caused by unbalance are considered. The dynamic harmonic domain is another derivation of the harmonic load-flow, which includes interharmonics and unbalanced networks (Medina et al., 2013).

The coupled admittance matrix is a non-iterative approach that takes advantages of the coupled admittance model of electronic devices (Sun et al., 2007). Being this model linear, the equations of harmonic voltages and currents, associated with nonlinear loads and with the network are solved simultaneously. On the other hand, the backward/

forward sweep, proposed by Teng & Chang (2007), is applied in two steps. Firstly, a backward sweep allows to calculate branch harmonic currents in a radial network. Then, a forward sweep is used to compute harmonic voltages at buses, from previously obtained harmonic currents.

Frequency domain probabilistic methods

Probabilistic methods can be classified as analytic or based on Monte Carlo simulation. In analytic methods based on the deterministic direct approach, magnitude and phase angles of harmonic currents are represented with Joint Probability Density Functions (JPDFs). Afterwards, JPDFs of harmonic voltages are computed (Carpinelli et al., 2001). Other analytic methods are achieved by linearizing the complete harmonic load-flow around mean values of harmonic voltages and currents. On the other hand, the Monte Carlo-based approaches involve the simulation of multiple scenarios of harmonic penetration (Caramia et al., 1994). In these methods, values of random variables are generated from PDFs. Then, a deterministic harmonic load-flow is run and the results are stored. The procedure is repeated until accurate results are obtained. Finally, the statistics of the output variables are computed.

Frequency domain possibilistic methods

A direct method of possibilistic harmonic load-flow was proposed by Romero et al. (2011b, 2012). The method uses possibility functions to represent input variables, and results are reported as possibility functions of harmonic voltage magnitudes. Another possibilistic method was presented by Dobróc et al. (2015). This hybrid approach is based on fuzzy logic and Monte Carlo simulation. Its application is focused on distribution networks

Hybrid methods (time-frequency)

In hybrid methods, network impedances and invariant linear loads are modeled in frequency domain, whereas nonlinear and variant loads are modeled in time domain. Harmonic voltage at buses is calculated by using an iterative procedure (Medina et al., 2013).

Table 2 shows the characteristics of each methodological contribution to the assessment of harmonic distortion in residential distribution networks and to PEVs harmonic impact assessment.

Discussion

The analysis of the literature review allowed the main issues to be identified with respect to the modeling and simulation of harmonic distortion in distribution networks.

Table 2. Characteristics of the methodologies for harmonic distortion assessment in distribution networks

Reference	Harmonic source modeling						Distribution network modeling					Penetration modeling		Simulation of harmonic propagation											
	Electrical				Operating									Frequency domain											
	Constant source	Decoupled Norton	Coupled Norton	Parametric model	Deterministic	Probabilistic	Deterministic				Probabilistic														
							Single-phase model	Multiphase model	Primary network	Secondary network	Distribution transformer	Deterministic	Probabilistic	Time domain	Direct method	Iterative analysis	Complete method	Multiphase analysis	Backward/ forward	Monte Carlo	Analytic method				
Orr et al. (1982a)				✓		✓																			
Orr et al. (1982b)				✓		✓																			
Orr et al. (1984)				✓		✓		✓	✓		✓	✓							✓						✓
Pileggi et al. (1993)	✓				✓		✓			✓			✓								✓				
Verderber et al. (1993)				✓		✓																			
Emanuel et al. (1994)					✓		✓			✓			✓								✓				
Cavallini et al. (1995)	✓					✓																			
Dwyer et al. (1995)				✓	✓			✓	✓	✓	✓	✓		✓						✓					
Emanuel et al., (1995)	✓				✓		✓			✓				✓						✓					
Mansoor et al. (1995a)				✓		✓																			
Mansoor et al. (1995b)				✓		✓	✓			✓	✓	✓						✓							✓
Bonner et al. (1996)	✓				✓		✓	✓	✓	✓	✓									✓					
Staats et al. (1997a)				✓		✓																			
Staats et al. (1997b)				✓		✓					✓	✓													✓
Staats et al. (1998)				✓		✓	✓			✓	✓	✓	✓												✓
Stankovic & Marengo (1998)	✓					✓																			
Y. J. Wang et al. (2001)		✓			✓			✓	✓	✓	✓	✓	✓		✓	✓									
Gómez & Morcos (2003)				✓		✓					✓	✓													
Suárez et al. (2005)	✓			✓	✓		✓			✓	✓	✓			✓										
Nassif & Xu (2009)	✓																								
Watson et al. (2009)		✓			✓		✓			✓	✓	✓	✓								✓				
Nassif et al. (2010)		✓			✓																				
Yong et al. (2010)			✓	✓	✓																				
Blanco & Parra (2011)	✓				✓		✓			✓	✓	✓	✓								✓				
Mazin et al. (2011)				✓	✓																				
Jiang et al. (2012)	✓				✓		✓	✓	✓	✓	✓			✓							✓				✓
Jouybari et al. (2012)				✓	✓	✓	✓			✓	✓	✓	✓								✓				
Salles et al. (2012)	✓				✓					✓															
Jiang et al. (2014)	✓				✓		✓	✓	✓	✓				✓							✓				✓
Molina & Sainz (2014)			✓	✓	✓																				
J. Wang et al. (2014)	✓			✓	✓	✓	✓			✓	✓	✓	✓								✓				✓
Gil-De-Castro et al. (2015)				✓	✓																				
Heidarian et al. (2015)				✓	✓		✓			✓				✓							✓				
Malagon et al. (2015)				✓	✓																				
Lucas et al. (2015)				✓	✓																				
Q. Wang et al. (2015)			✓	✓	✓																				
Romero et al. (2015)	✓	✓	✓																						
Silva et al. (2015)	✓				✓		✓	✓	✓	✓	✓	✓	✓								✓				✓
Tovilović & Rajaković (2015)	✓				✓	✓	✓	✓	✓	✓	✓	✓	✓								✓				✓

Reference	Harmonic source modeling						Distribution network modeling					Penetration modeling		Simulation of harmonic propagation						
	Electrical				Operating									Frequency domain						
	Constant source	Decoupled Norton	Coupled Norton	Parametric model	Deterministic	Probabilistic	Deterministic				Probabilistic									
							Time domain	Direct method	Iterative analysis	Complete method	Multiphase analysis	Backward/ forward	Monte Carlo	Analytic method						
Silva et al. (2015)	✓				✓		✓	✓	✓	✓	✓						✓			
Tovilović & Rajaković (2015)	✓				✓	✓		✓	✓	✓	✓						✓			
Aljanad & Mohamed (2016)		✓			✓		✓	✓	✓	✓	✓						✓			
Bagheri et al. (2016)	✓				✓		✓	✓			✓									
Sharma et al. (2016)	✓				✓		✓	✓	✓	✓	✓				✓		✓			
Meyer et al. (2017)	✓				✓															
Molina et al. (2017)			✓	✓	✓		✓	✓	✓	✓	✓		✓							
Tang et al. (2017)		✓			✓															
Xiao et al. (2017)				✓	✓															

Source: Authors

These issues should be considered to obtain an accurate assessment in scenarios of large-scale penetration of multiple nonlinear loads:

- Harmonic interaction between nonlinear loads and impedances of the network, *i.e.*, the interaction between harmonic voltages and currents of different orders drawn by nonlinear loads. This phenomenon causes that magnitude of harmonic currents are attenuated or amplified, mainly depending on magnitude and phase angle of voltage harmonics
- Diversity on phase angles of harmonic currents drawn by different nonlinear loads, mainly depending on the type of load, rated power, line impedance (between the nonlinear load and the PCC), and its X/R ratio. Diversity on phase angles leads to partial cancellation of harmonic currents
- Unbalance in the operation of distribution networks, which causes the propagation of uncharacteristic harmonics
- Uncertainty in operation and composition of loads, due to diverse operating states of devices, different usage habits by end-users, as well as the lack of information of loads connected to the network. Uncertainty causes that harmonic distortion can be only estimated with a certain probability.

The higher the harmonic penetration level of harmonic sources in the network, the greater the influence of the aforementioned issues on results. Table 3 reports the general methods for simulating the propagation of harmonics, as described in previous sections. Aspects that can be straightforwardly modeled in each general method are indicated. Moreover, there are approaches that combine

two or more methods of Table 3, thus, various aspects can be taken into account simultaneously. For instance, methods based on Monte Carlo simulation and the direct method have been developed, hence, these allow the diversity effect and uncertainties to be considered.

Table 3. Main aspects considered by general methods for simulation

Domain	Method	Interaction	Diversity	Unbalance	Uncertainty			
					Linear loads		Non-linear loads	
					O.	C.	O.	C.
Time	Conventional	✓	✓	✓				
	Fast solution	✓	✓	✓				
Frequency (deterministic)	Direct			✓				
	Iterative	✓	✓					
	Complete	✓						
	Dynamic			✓				
	Coupled admittance	✓	✓					
	Multiphase			✓				
	Backward/forward			✓				
Frequency (probabilistic)	Analytic				✓	✓	✓	✓
	Monte Carlo				✓	✓	✓	✓
Frequency (possibilistic)	Direct				✓	✓	✓	✓
	Monte Carlo-fuzzy							
Time-frequency	Time-frequency	✓	✓	✓				

O: Operation. C: Composition.

Source: Authors

Table 4 presents the main methodologies for assessing harmonic distortion in residential distribution networks,

which were previously described in the literature review. Aspects into consideration, *i.e.*, interaction, diversity, unbalance, and uncertainty, in each approach are

indicated. Only complete methodologies are listed, *i.e.*, those including the four stages described in previous sections.

Table 4. Main aspects considered by specific methodologies for harmonic analysis in residential distribution networks

Reference	Interaction	Diversity	Unbalance	Uncertainty				Main advantage	Main disadvantage
				Linear loads		Nonlinear loads			
				O.	C.	O.	C.		
Orr et al. (1982a)								Suitable modeling of the variant operation of harmonic sources.	Distribution of harmonic sources throughout the network is not considered.
Orr et al. (1982b)						✓	✓		
Orr et al. (1984)									
Pileggi et al. (1993)								The future impact of harmonic sources can be forecast.	Neither interaction nor uncertainties are taken into account.
Emanuel et al. (1994)									
Emanuel et al., (1995)									
Cavallini et al. (1995)						✓	✓	Modeling of the operation of harmonic sources is detailed, due to the analytic nature.	Neither interaction nor unbalance is taken into account.
Dwyer et al. (1995)	✓	✓	✓					Modeling of harmonic currents is accurate, due to the time domain simulation.	The application to large-scale penetration scenarios is limited due to computational effort.
Mansoor et al. (1995a)	✓	✓						The modeling of harmonic currents is accurate, due to consideration of interaction and diversity.	Random nature (uncertainty) of harmonics is not taken into account.
Mansoor et al. (1995b)									
Bonner et al. (1996)			✓					Several models and simulation techniques for harmonic analysis are presented.	Neither interaction nor uncertainties are taken into account.
Staats et al. (1997a)								Modeling of PEVs operation is detailed. The computational effort is reduced.	Harmonic interaction is not taken into account.
Staats et al. (1997b)		✓				✓	✓		
Staats et al. (1998)									
Stankovic & Marengo (1998)						✓	✓	Stochastic processes associated with memory (Markov chains) are suitably modeled.	Neither interaction nor unbalance is taken into account.
Jiang et al. (2012)								Consumer behavior and regulation changes can be taken into account due to the bottom-up approach.	Harmonic interaction is not taken into account.
Salles et al. (2012)		✓	✓	✓	✓	✓	✓		
Jiang et al. (2014)									
Heidarian et al. (2015)	✓	✓						Modeling of harmonic currents is accurate, due to the complete harmonic load-flow.	Unbalance and uncertainties are not taken into account.
Silva et al. (2015)		✓	✓	✓	✓	✓	✓	Aggregated nonlinear load models can be efficiently obtained.	Slight understanding is provided for the interaction and diversity effects.
Tovilović & Rajaković (2015)						✓	✓	The impact of photovoltaic systems and PEVs is assessed simultaneously.	Slight detail in modeling PEV battery chargers as harmonic sources is presented.
Aljanad & Mohamed (2016)								The computational effort is reduced. Circuit power losses due to harmonics are analyzed.	Slight detail in modeling PEV battery chargers as harmonic sources is presented.
Sharma et al. (2016)		✓	✓					Modeling of the network is detailed. Future scenarios are analyzed.	Neither interaction nor uncertainties are taken into account.

Source: Authors

Conclusions

Harmonic distortion caused by multiple low-power nonlinear loads has mainly negative impacts, such as reducing the life-span of various assets of the distribution network (transformers, conductors, protective systems,

etc.), according to the literature review. The increase in these negative effects is expected, since new nonlinear loads, such as PEVs, CFLs and LED lamps, will be progressively incorporated to power networks. Thus, the importance of analyzing the impact of modern nonlinear loads on harmonic distortion is apparent. Moreover, the

random nature of residential nonlinear loads introduces complexity in predicting their collective impact, hence, further research in this issue is required.

According to the literature review, the harmonic interaction effect is important and should be taken into account, especially in scenarios of large-scale penetration of distributed nonlinear loads. These nonlinear loads would interact differently with the network depending upon their front-end topology (e.g., without power factor correction, with passive power factor correction, or with active power factor correction).

The detailed modeling of the effect of harmonic interaction in frequency domain requires iterative methods that need significant computational effort. This effort increases if uncertainties are analyzed by Monte Carlo simulations. Simplified models have been developed (Norton coupled type) for some distorting loads, which accurately represent the harmonic interaction in frequency domain. Nonetheless, the integration of these type of models into the Monte Carlo simulation method should be further studied.

Aspects analyzed in Table 4, which are required for an adequate assessment of harmonic distortion in scenarios with multiple harmonic sources, have not been considered simultaneously by current methodologies. These aspects refer to: harmonic interaction, diversity effect, unbalanced operation, and uncertainty in operation and composition of linear and nonlinear loads. Therefore, future research can be conducted in the formulation of an integral method to analyze the complex but interacting issues.

Acknowledgements

Financial supports from the Consejo Nacional de Investigaciones Científicas y Técnicas (CONICET), the Deutscher Akademischer Austauschdienst (DAAD), and the Ministerio de Ciencia, Tecnología e Innovación Productiva (MINCyT), Argentina, under grant PICT 0388–2012, are gratefully acknowledged.

References

- Aljanad, A., & Mohamed, A. (2016). *Harmonic Impact of Plug-In Hybrid Electric Vehicle on Electric Distribution System*. Modelling and Simulation in Engineering, 2016.
- Bagheri, P., & Xu, W. (2014). *A technique to mitigate zero-sequence harmonics in power distribution systems*. IEEE Transactions on Power Delivery, 29(1).
- Bagheri, P., Xu, W., & Ding, T. (2016). *A Distributed Filtering Scheme to Mitigate Harmonics in Residential Distribution Systems*. IEEE Transactions on Power Delivery, 31(2).
- Barros, J., Diego, R. I., & De Apraiz, M. (2013). *A discussion of new requirements for measurement of harmonic distortion in modern power supply systems*. IEEE Transactions on Instrumentation and Measurement, 62(8).
- Blanco, A. M., & Parra, E. E. (2011). *The effects on radial distribution networks caused by replacing incandescent lamps with compact fluorescent lamps and LEDs*. Ingeniería E Investigación, 31(2 SUPPL.).
- Bonner, A., Grebe, T., Gunther, E., Hopkins, L., Marz, M. B., Mahseredjian, J., ... Xu, W. (1996). *Modeling and simulation of the propagation of harmonics in electric power networks. Part I: Concepts, models, and simulation techniques*. IEEE Transactions on Power Delivery, 11(1).
- Caicedo, J., Mamani, M., Lopez, S., Romero, A. A., Zini, H., & Ratta, G. (2014). *Impactos de la conexión de vehículos eléctricos en sistemas de potencia - Revisión literaria*. In 2014 IEEE Biennial Congress of Argentina, ARGENCON 2014.
- Caramia, P., Carpinelli, G., Rossi, F., & Verde, P. (1994). *Probabilistic iterative harmonic analysis of power systems*. IEE Proceedings: Generation, Transmission and Distribution, 141(4).
- Carpinelli, G., Esposito, T., Varilone, P., & Verde, P. (2001). *First-order probabilistic harmonic power flow*. IEE Proceedings - Generation, Transmission and Distribution, 148(6), 541.
- Cavallini, A., Cacciari, M., & Montanari, G. C. (1995). *Stochastic evaluation of harmonics at network buses*. IEEE Transactions on Power Delivery, 10(3).
- Das, J. C. (2015). *Power System Harmonics and Passive Filter Designs*. Power System Harmonics and Passive Filter Designs.
- Dobrić, G., Žarković, M., & Šošić, D. (2015). *Fuzzy-based Monte Carlo simulation for harmonic load flow in distribution networks*. IET Generation, Transmission & Distribution, 9(3), 267–275.
- Duarte, C. H., & Schaeffer, R. (2010). *Economic impacts of power electronics on electricity distribution systems*. Energy, 35(10).
- Dwyer, R., Khan, A. K., McGranaghan, M., Tang, L., McCluskey, R. K., Sung, R., & Houy, T. (1995). *Evaluation of Harmonic Impacts from Compact Fluorescent Lights On Distribution Systems*. IEEE Transactions on Power Systems, 10(4).
- Emanuel, A. E., Janczak, J., Gulachenski, E. M., Breen, M., Sorensen, D., Pileggi, D. J., & Gentile, T. J. (1995). *Distribution feeders with nonlinear loads in the northeast U.S.A.: Part i - voltage distortion forecast*. IEEE Transactions on Power Delivery, 10(1).
- Emanuel, A. E., Janczak, J., Pileggi, D. J., Gulachenski, E. M., Root, C. E., Breen, M., & Gentile, T. J. (1994). *Voltage distortion in distribution feeders with nonlinear loads*. IEEE Transactions on Power Delivery, 9(1).
- Emanuel, A. E., Orr, J. A., Cyganski, D., & Gulachenski, E. M. (1991). *A survey of harmonic voltages and currents at distribution substations*. IEEE Transactions on Power Delivery, 6(4).
- Emanuel, A. E., Orr, J. A., Cyganski, D., & Gulachenski, E. M. (1993). *A survey of harmonic voltages and currents at the customer's bus*. IEEE Transactions on Power Delivery, 8(1).
- Gil-De-Castro, A., Rönnberg, S. K., Bollen, M. H. J., & Moreno-Muñoz, A. (2015). *Harmonic phase angles for a domestic customer with different types of lighting*. International Transactions on Electrical Energy Systems, 25(7).

- Gómez, J. C., & Morcos, M. M. (2003). *Impact of EV battery chargers on the power quality of distribution systems*. IEEE Transactions on Power Delivery, 18(3).
- Heidarian, T., Joorabian, M., & Reza, A. (2015). *The effect of plug-in electric vehicles on harmonic analysis of smart grid*. International Journal of Emerging Electric Power Systems, 16(6).
- Hicks, D., & Melkers, J. (2013). *Bibliometrics as a tool for research evaluation. Handbook on the Theory and Practice of Program Evaluation*.
- International Energy Agency. (2017). *Global EV Outlook*.
- Jewel, W., Miller, W. L., & Casey, T. (2000). *Filtering dispersed harmonic sources on distribution*. IEEE Transactions on Power Delivery, 15(3).
- Jiang, C., Torquato, R., Salles, D., & Xu, W. (2014). *Method to assess the power-quality impact of plug-in electric vehicles*. IEEE Transactions on Power Delivery, 29(2).
- Jouybari-Moghaddam, H., Alimardani, A., & Hosseinian, S. H. (2012). *Influence of electric vehicle charging rates on transformer derating in harmonic-rich battery charger applications*. Archives of Electrical Engineering, 61(4).
- Lindahl, J. (2012). *Motivation research in the field of sport and exercise psychology: A bibliometric study of research themes and information flow between 1985 and 2009*. Umeå University.
- Lucas, A., Bonavitacola, F., Kotsakis, E., & Fulli, G. (2015). *Grid harmonic impact of multiple electric vehicle fast charging*. Electric Power Systems Research, 127.
- Malagon-Carvajal, G., Bello-Peña, J., Ordóñez Plata, G., & Duarte Gualdrón, C. (2015). *Analytical and experimental discussion of a circuit-based model for compact fluorescent lamps in a 60 Hz power grid*. Ingeniería E Investigación, 35(1).
- Mansoor, A., Grady, W. M., Chowdhury, A. H., & Samotyj, M. J. (1995a). *An Investigation of Harmonics Attenuation and Diversity Among Distributed Single-Phase Power Electronic Loads*. IEEE Transactions on Power Delivery, 10(1), 467–473.
- Mansoor, A., Grady, W. M., & Staats, P. T. (1995b). *Predicting the Net Harmonic Currents Produced by Large Numbers of Distributed Single-Phase Computer Loads*. IEEE Transactions on Power Delivery, 10(4).
- Masoum, M. A. S., & Fuchs, E. F. (2015). *Power Quality in Power Systems and Electrical Machines: Second Edition*. Power Quality in Power Systems and Electrical Machines: Second Edition.
- Mazin, H. E., Nino, E. E., Xu, W., & Yong, J. (2011). *A study on the harmonic contributions of residential loads*. IEEE Transactions on Power Delivery, 26(3).
- Medina, A., Segundo, J., Ribeiro, P., Xu, W., Lian, K. L., Chang, G. W., ... Watson, N. R. (2013). *Harmonic analysis in frequency and time domain*. IEEE Transactions on Power Delivery, 28(3), 1813–1821.
- Meyer, J., Blanco, A.-M., Domagk, M., & Schegner, P. (2017). *Assessment of Prevailing Harmonic Current Emission in Public Low-Voltage Networks*. IEEE Transactions on Power Delivery, 32(2).
- Molina, J., Mesas, J. J., Mesbahi, N., & Sainz, L. (2017). *LED lamp modelling for harmonic studies in distribution systems*. IET Generation, Transmission and Distribution, 11(4).
- Molina, J., & Sainz, L. (2014). *Model of electronic ballast compact fluorescent lamps*. IEEE Transactions on Power Delivery, 29(3).
- Munir, M. S., Li, Y. W., & Tian, H. (2016). *Improved Residential Distribution System Harmonic Compensation Scheme Using Power Electronics Interfaced DGs*. IEEE Transactions on Smart Grid, 7(3).
- Nassif, A. B., & Xu, W. (2009). *Characterizing the harmonic attenuation effect of compact fluorescent lamps*. IEEE Transactions on Power Delivery, 24(3).
- Nassif, A. B., Yong, J., & Xu, W. (2010). *Measurement-based approach for constructing harmonic models of electronic home appliances*. IET Generation, Transmission and Distribution, 4(3).
- Nassif, A. B., Yong, J., Xu, W., & Chung, C. Y. (2012). *Indices for comparative assessment of the harmonic effect of different home appliances*. International Transactions on Electrical Energy Systems, 23(5).
- Orr, J. A., Emanuel, A. E., & Oberg, K. W. (1982a). *Current Harmonics Generated by a Cluster of Electric Vehicle Battery Chargers*. IEEE Transactions on Power Apparatus and Systems, PAS-101(3).
- Orr, J. A., Emanuel, A. E., & Pileggi, D. G. (1982b). *Current harmonics, voltage distortion, and powers associated with battery chargers: Part I: Comparisons among different types of chargers*. IEEE Transactions on Power Apparatus and Systems, PAS-101(8).
- Orr, J. A., Emanuel, A. E., & Pileggi, D. J. (1984). *Current harmonics, voltage distortion, and powers associated with electric vehicle battery chargers distributed on the residential power system*. IEEE Transactions on Industry Applications, IA-20(4).
- Person, O. (2010). *Identifying research themes with weighted direct citation links*. Journal of Informetrics, 4(3).
- Pileggi, D. J., Gulachenski, E. M., Root, C. E., Gentile, T. J., & Emanuel, A. E. (1993). *The effect of modern compact fluorescent lights on voltage distortion*. IEEE Transactions on Power Delivery, 8(3).
- Romero-L, M. F., Gallego, L. E., Müller, S., & Meyer, J. (2015). *Characterization of non-linear household loads for frequency domain modeling*. Ingeniería E Investigación, 35(1).
- Romero, A. A., Zini, H. C., & Ratta, G. (2011a). *An overview of approaches for modelling uncertainty in harmonic load-flow*. Ingeniería E Investigación, 31(2 SUPPL).
- Romero, A. A., Zini, H. C., & Rattá, G. (2012). *Modelling input parameter interactions in the possibilistic harmonic load flow*. IET Generation, Transmission and Distribution, 6(6).
- Romero, A. A., Zini, H. C., Rattá, G., & Dib, R. (2011b). *Harmonic load-flow approach based on the possibility theory*. IET Generation, Transmission and Distribution, 5(4).

- Salles, D., Jiang, C., Xu, W., Freitas, W., & Mazin, H. E. (2012a). *Assessing the collective harmonic impact of modern residential loads-part I: Methodology*. IEEE Transactions on Power Delivery, 27(4), 1937–1946.
- Salles, D., Jiang, C., Xu, W., Freitas, W., & Mazin, H. E. (2012b). *Assessing the collective harmonic impact of modern residential loads-part I: Methodology*. IEEE Transactions on Power Delivery, 27(4), 1937–1946.
- Santiago, I., López-Rodríguez, M. A., Gil-de-Castro, A., Moreno-Munoz, A., & Luna-Rodríguez, J. J. (2013). *Energy consumption of audiovisual devices in the residential sector: Economic impact of harmonic losses*. Energy, 60.
- Sharma, H., Rylander, M., & Dorr, D. (2016). *Grid impacts due to increased penetration of newer harmonic sources*. IEEE Transactions on Industry Applications, 52(1).
- Silva, M. M., Losada y Gonzalez, M., Urtubey, W., Carrano, E. G., & Silva, S. R. (2015). *Evaluating harmonic voltage distortion in load-varying unbalanced networks using Monte Carlo simulations*. IET Generation, Transmission and Distribution, 9(9).
- Speidel, S., & Bräunl, T. (2014). *Driving and charging patterns of electric vehicles for energy usage*. Renewable and Sustainable Energy Reviews, 40.
- Staats, P. T., Grady, W. M., Arapostathis, A., & Thallam, R. S. (1997a). *A procedure for derating a substation transformer in the presence of widespread electric vehicle battery charging*. IEEE Transactions on Power Delivery, 12(4).
- Staats, P. T., Grady, W. M., Arapostathis, A., & Thallam, R. S. (1997b). *A statistical method for predicting the net harmonic currents generated by a concentration of electric vehicle battery chargers*. IEEE Transactions on Power Delivery, 12(3).
- Staats, P. T., Grady, W. M., Arapostathis, A., & Thallam, R. S. (1998). *A statistical analysis of the effect of electric vehicle battery charging on distribution system harmonic voltages*. IEEE Transactions on Power Delivery, 13(2).
- Stankovic, A. M., & Marengo, E. A. (1998). *A dynamic characterization of power system harmonics using Markov chains*. IEEE Transactions on Power Systems, 13(2).
- Suárez, J. A., Di Mauro, G. F., Anaut, D., & Agüero, C. (2005). *Analysis of the harmonic distortion and the effects of attenuation and diversity in residential areas | Análisis de la distorsión armónica y los efectos de atenuación y diversidad en áreas residenciales*. IEEE Latin America Transactions, 3(5).
- Sun, Y., Zhang, G., Xu, W., & Mayordomo, J. G. (2007). *A harmonically coupled admittance matrix model for AC/DC converters*. IEEE Transactions on Power Systems, 22(4).
- Tang, B., Ma, S., Lin, S., Chen, G., & Fu, Y. (2017). *Harmonic current emission level assessment of residential loads based on impedance-gathering trend*. International Transactions on Electrical Energy Systems, 27(5).
- Teng, J.-H., Liao, S.-H., & Leou, R.-C. (2014). *Three-phase harmonic analysis method for unbalanced distribution systems*. Energies, 7(1).
- Teng, J. H., & Chang, C. Y. (2007). *Backward/forward sweep-based harmonic analysis method for distribution systems*. IEEE Transactions on Power Delivery, 22(3), 1665–1672.
- Tovilović, D. M., & Rajaković, N. L. J. (2015). *The simultaneous impact of photovoltaic systems and plug-in electric vehicles on the daily load and voltage profiles and the harmonic voltage distortions in urban distribution systems*. Renewable Energy, 76.
- Verderber, R. R., Morse, O. C., & Alling, W. R. (1993). *Harmonics from compact fluorescent lamps*. IEEE Transactions on Industry Applications, 29(3).
- Wang, J., Cui, Y., & Zhu, M. (2014). *Probabilistic harmonic calculation in distribution networks with electric vehicle charging stations*. Journal of Applied Mathematics, 2014.
- Wang, Q., Zhou, N., Wang, J., & Wei, N. (2015). *Harmonic amplification investigation and calculation of electric vehicle charging stations using three-phase uncontrolled rectification chargers*. Electric Power Systems Research, 123.
- Wang, Y.-J., O'Connell, R. M., & Brownfield, G. (2001). *Modelling and prediction of distribution system voltage distortion caused by nonlinear residential loads*. IEEE Transactions on Power Delivery, 16(4).
- Watson, N. R., Scott, T. L., & Hirsch, S. J. J. (2009). *Implications for distribution networks of high penetration of compact fluorescent lamps*. IEEE Transactions on Power Delivery, 24(3).
- Xia, D., & Heydt, G. (1982). *Harmonic Power Flow Studies - Part II Implementation and Practical Application*. IEEE Transactions on Power Apparatus and Systems, PAS-101(6), 1266–1270.
- Xiao, X., Collin, A. J., Djokic, S. Z., Yanchenko, S., Moller, F., Meyer, J., ... Testa, A. (2017). *Analysis and Modelling of Power-Dependent Harmonic Characteristics of Modern PE Devices in LV Networks*. IEEE Transactions on Power Delivery, 32(2).
- Yong, J., Chen, L., & Chen, S. (2010). *Modelling of home appliances for power distribution system harmonic analysis*. IEEE Transactions on Power Delivery, 25(4).